


# NRG Zone - System Schematic -25

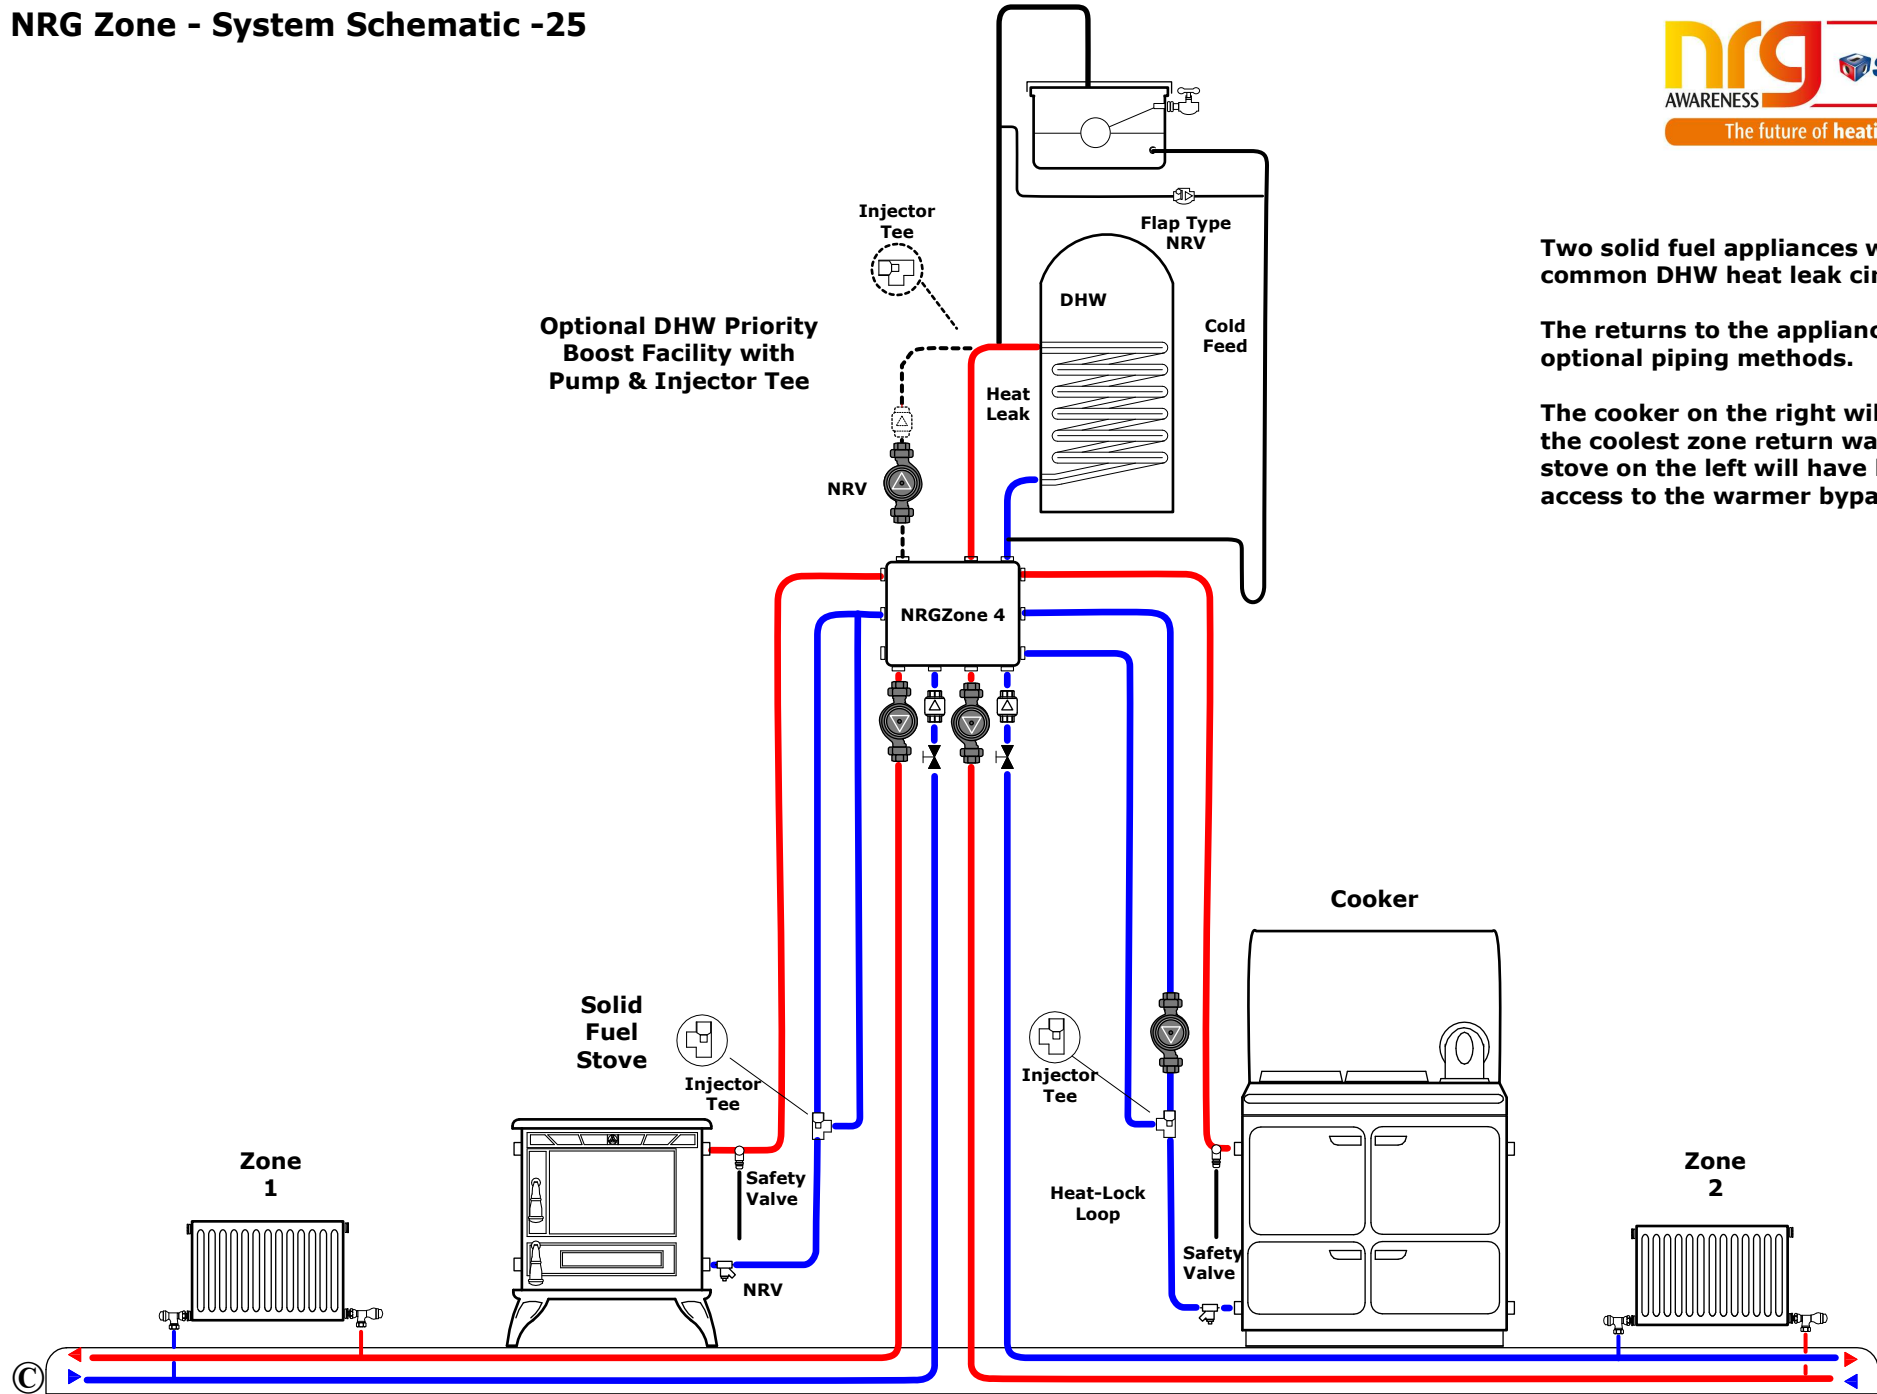

Optional DHW Priority Boost Facility with Pump & Injector Tee

Two solid fuel appliances with a common DHW heat leak circuit.

The returns to the appliances show optional piping methods.

The cooker on the right will draw from the coolest zone return water and the stove on the left will have better access to the warmer bypassing water.